

EQUIPMENT SCHEDULE									
ITEM NO	QTY	EQUIPMENT CATEGORY	HVAC MAKE-UP DUCT SIZE (IN)	HVAC MAKE-UP CFM	MAKE-UP SPWG	EXHAUST DUCT SIZE (IN)	EXHAUST CFM	EXHAUST SPWG	HVAC REMARKS
207	1	HOOD	6X25	1154	.206	12X10	1442	.357	
224R	1	HOOD	6X36	1538	.251	12X12	1743	.443	
224L	1	HOOD	6X36	1538	.251	12X15	2155	.440	
225	1	HOOD	6X36	1538	.251	12X15	2155	.440	
274	1	EXHAUST DUCT FRONT				4X16	200	.65	
274	1	EXHAUST DUCT BACK				4X16	350	.65	

**BUILDING CONDITIONS NOTES**

NOTE A: FLOORSPACE EQUIPMENT CONTINGENCIES TO FLOORSPACE LOCATIONS OR MAKE-UP AIRING EQUIPMENT LOCATIONS TO BE DETERMINED BY THE GENERAL CONTRACTOR TO INSURE THE PROPER SIZING OF THE GENERAL CONTRACTOR'S SUPPLY AIR EXHAUSTS AND EXHAUSTS TO FLOORSPACE EQUIPMENT TO BE INSTALLED IN THE BUILDING.

NOTE B: THIS BUILDING CONDITIONS AND VENTILATION PLAN IS INTENDED FOR THE APPROVED SHOP DRAWINGS FOR SUPPLEMENTAL CONSTRUCTION AND INSTALLATION REQUIREMENTS FOR THE CONSTRUCTION AND INSTALLATION OF THE EQUIPMENT. REFER TO THE APPROVED SHOP DRAWINGS FOR EXISTING AND GENERAL USES FOR ANY MOVING EQUIPMENT IN THE EXISTING BUILDING. THE GENERAL CONTRACTOR SHALL VERIFY THE EXISTING BUILDING CONDITIONS AND VENTILATION REQUIREMENTS AND THE BUILDING CONDITIONS AND VENTILATION PLAN SHALL BE REVISED AS NECESSARY TO ACCOMMODATE THE EQUIPMENT. THE GENERAL CONTRACTOR SHALL VERIFY THE EXISTING BUILDING CONDITIONS AND VENTILATION REQUIREMENTS AND THE BUILDING CONDITIONS AND VENTILATION PLAN SHALL BE REVISED AS NECESSARY TO ACCOMMODATE THE EQUIPMENT.

NOTE C: REFER TO THE APPROVED SHOP DRAWINGS FOR SUPPLEMENTAL CONSTRUCTION AND INSTALLATION REQUIREMENTS FOR THE CONSTRUCTION AND INSTALLATION OF THE EQUIPMENT.

NOTE D: THE WALLS, CEILING AND FLOORS IN THE KITCHEN, COFFERED, NON-ASSEMBLY/NOB BAYS AND SERVICE BAYS SHALL BE PAINTED WITH A PAINTED DRY WALL IS NOT ACCEPTABLE.

NOTE E: THE FLOORING HAS BEEN INSTALLED AND WASHED CLEAN. THE GENERAL CONTRACTOR SHALL VERIFY THE EXISTING BUILDING CONDITIONS AND VENTILATION REQUIREMENTS AND THE BUILDING CONDITIONS AND VENTILATION PLAN SHALL BE REVISED AS NECESSARY TO ACCOMMODATE THE EQUIPMENT.

NOTE F: THE WORKED HEIGHT FOR THE BOTTOM EDGE OF THE HOORS TO BE 6'-0" ABOVE FINISHED FLOOR OR PER LOCAL CODES REQUIREMENTS. ALL EXHAUST/COMPENSATE HOODS AND DUCTS SHALL BE 6'-0" ABOVE FINISHED FLOOR OR PER LOCAL CODES REQUIREMENTS.

NOTE G: HOODS SHALL BE INSTALLED AT 5/8" SLOPE CONNECTED TO SLOPE TOWARD RISER/DESCEND MACHINE WITH 1/8" GAPS BETWEEN HOODS, VERIFY AND COMPLY WITH ALL APPLICABLE CODES.

NOTE H: BALANCE DAMPERS AND EXHAUST DAMPERS SHALL BE INSTALLED IN THE EXHAUST DUCTS TO MAINTAIN THE EXHAUST FLOW. THE GENERAL CONTRACTOR SHALL VERIFY THE EXHAUST FLOW AND COMPLY WITH ALL APPLICABLE CODES.

NOTE I: ALL EXHAUST HOOD ASSEMBLIES, DUCTS, COMPONENTS, ETC. SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ALL APPLICABLE CODES AND REGULATIONS.

NOTE J: PROVIDE A 6" DEEP DEPRESSION FOR ALL WALK-IN COOLERS/FREEZERS, WITH A SLOPE AND TRANSIT TIE TO DRAIN. THE EXCESS FLOOR MATERIALS AND COVER BASES ARE TO BE INSTALLED AFTER THE EQUIPMENT IS INSTALLED. THE GENERAL CONTRACTOR SHALL VERIFY THE EQUIPMENT BEING INSTALLED BESSER FAN SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ALL APPLICABLE CODES AND REGULATIONS.

NOTE K: ALL REQUIRED MATERIALS TO MAKE THE FINAL CONNECTIONS TO ALL REQUIRED EQUIPMENT CONNECTION PROVIDED EQUIPMENT. THE GENERAL CONTRACTOR SHALL VERIFY THE EQUIPMENT BEING INSTALLED BESSER FAN SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ALL APPLICABLE CODES AND REGULATIONS.

NOTE L: PROVIDE A 6" DEEP DEPRESSION FOR ALL WALK-IN COOLERS/FREEZERS, WITH A SLOPE AND TRANSIT TIE TO DRAIN. THE EXCESS FLOOR MATERIALS AND COVER BASES ARE TO BE INSTALLED AFTER THE EQUIPMENT IS INSTALLED. THE GENERAL CONTRACTOR SHALL VERIFY THE EQUIPMENT BEING INSTALLED BESSER FAN SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ALL APPLICABLE CODES AND REGULATIONS.


NOTE M: PROVIDE FIRE RATED MATERIALS AND/OR INSULATION AS PROVIDED BY THE EQUIPMENT MANUFACTURER. THE GENERAL CONTRACTOR SHALL VERIFY THE EQUIPMENT BEING INSTALLED BESSER FAN SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ALL APPLICABLE CODES AND REGULATIONS.

NOTE N: PROVIDE REFRIGERATION LINES SHALL HAVE 1" AT ALL BENDS AND A MINIMUM OF 1/8" X 1/2" DEEP ACCEPTABLE FLOORS OR CONCEALED SPACES. THE TOTAL OF ALL BENDS BETWEEN RIG LINES SHALL NOT EXCEED 180°. RIG LINES SHALL BE INSTALLED IN ACCORDANCE WITH LOCAL CODES AND REGULATIONS.

NOTE O: ALL HOODS OR SERVICE HOODS, WALLS AND CEILING, ELECTRICAL OR PLUMBING LINES AS SHOWN ON THIS PLAN, THE HOLES AND SERVICES AFTER INSTALLATION OF THE LINES, SHALL BE INSTALLED IN ACCORDANCE WITH LOCAL CODES AND REGULATIONS. VERIFY COMPLIANCE WITH LOCAL CODES AND REGULATIONS.

NOTE P: A MINIMUM OF 150 LBS. PER SQUARE FOOT FLOOR LOADING, OR HIGHER AS REQUIRED BY LOCAL CODES.

NOTE Q: EXHAUSTS ARE REQUIRED IN KITCHEN AREA TO AVOID HEAT MOISTURE BUILD-UP.

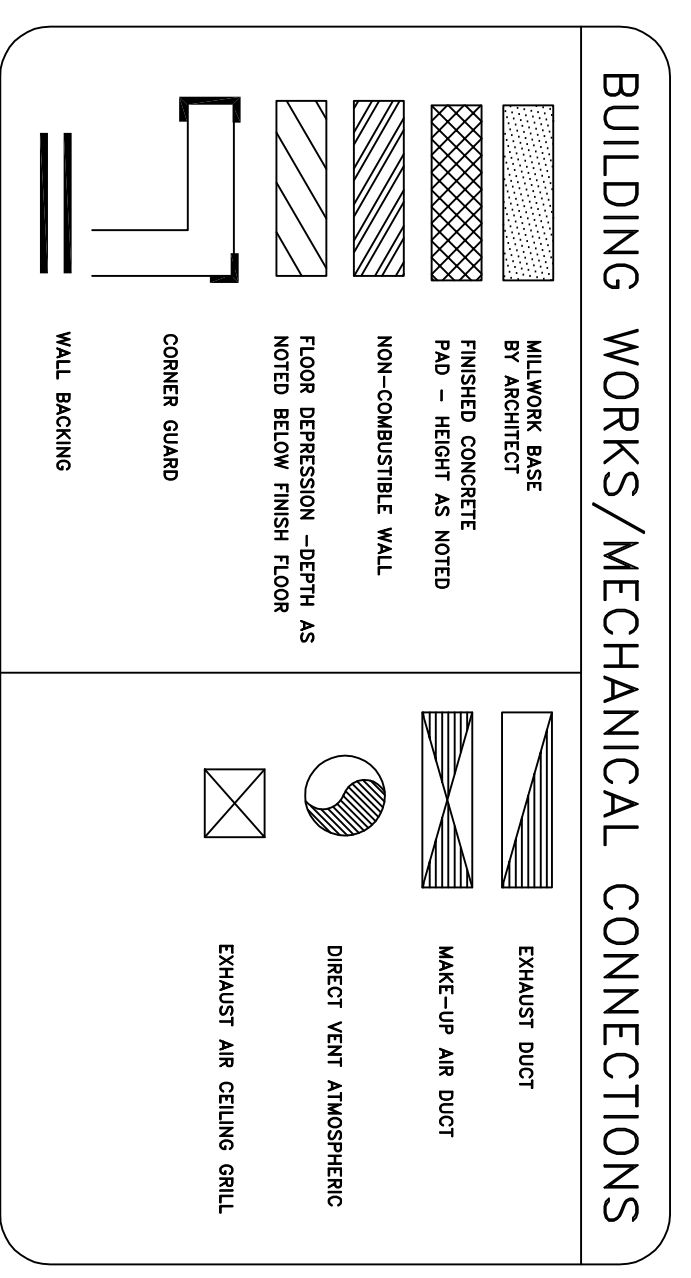

**OZ ARCHITECTURE**

3012 Huron Street  
Suite 100  
Denver, Colorado 80202  
phone 303.861.5704

**THE ROSSONIAN**  
2650 WELTON STREET  
DENVER, COLORADO 80205

PROJ. NO. 57027.00  
DRAWN: PM  
CHECKED: PM  
CADD FILE:  
DATE: 07/20/2007  
REVISIONS:

©OZ ARCHITECTURE

100% CONSTRUCTION DOCUMENTS  
SHEET TITLE:  
FIRST FLOOR EXHAUST/BLDG PLAN  
SCALE:  
SHEET NUMBER:  
**KB-1.4**